



www.haleyaldrich.com

**REPORT ON
2017 ANNUAL GROUNDWATER MONITORING AND
CORRECTIVE ACTION REPORT
A.B. BROWN GENERATING STATION
WEST FRANKLIN, INDIANA**

by Haley & Aldrich, Inc.
Greenville, South Carolina

for Southern Indiana Gas and Electric Company (SIGECO)
Evansville, Indiana

File No. 129420-003
January 2018

Annual Groundwater Monitoring Report Summary

Haley & Aldrich, Inc. (Haley & Aldrich) has prepared this 2017 Annual Groundwater Monitoring Corrective Action Report for the A.B. Brown Generating Station (ABB). This 2017 Annual Report was developed to comply with the United States Environmental Protection Agency (USEPA) Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals (CCR) from Electric Utilities, 40 CFR Part 257, Subpart D dated 17 April 2015 (Rule), specifically subsection §257.90(e)(1) through (5). Southern Indiana Gas and Electric Company (SIGECO) operates the existing coal combustion residuals (CCR) management unit referred to as Ash pond at ABB located in Posey County, Indiana near the community of West Franklin. This CCR unit is subject to the Rule since it was active as of the effective date of the Rule.

This annual report addresses the CCR management unit, referred to as Ash pond, at ABB, as described in the Groundwater Monitoring Program report, which was certified and placed in the facility's operating record on October 17, 2017 as required by §257.105(h)(2) and posted on the facility's website on November 16, 2017 as required by §257.107(h)(2).

To report on the activities conducted during the prior calendar year and document compliance with the Rule, the specific requirements listed in §257.90(e)(1) through (5) are provided below in bold/italic type followed by a short narrative addressing how that specific requirement was met.

§257.90 APPLICABILITY

§257.90(e) Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by §257.105(h)(1).

As required, this annual report documents the status of the groundwater monitoring program for the CCR management unit at ABB and summarizes key actions completed during the prior calendar year.

At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:

§257.90(e)(1) AERIAL IMAGE OF GROUNDWATER MONITORING PROGRAM

§257.90(e)(1) A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;

As required by §257.90(e)(1), maps showing the location of the Ash pond and associated upgradient and downgradient monitoring wells are included in this report as **Figure 1**. In addition, this information is presented in the Groundwater Monitoring Program report prepared for ABB, which was placed in the facility's operating record on October 17, 2017 as required by §257.105(h)(2).

§257.90(e)(2) ADJUSTMENTS TO GROUNDWATER MONITORING PROGRAM

§257.90(e)(2) Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;

To comply with the requirements of §257.91, a groundwater monitoring network of nine (9) wells were installed for the Ash pond at ABB. Details of the design, and construction of the monitoring wells are summarized in Table 1. Additional description of the monitoring network is presented in the Groundwater Monitoring Program report, which was placed in the facility's operating record on October 17, 2017, as required by §257.105(h)(2). None of the wells installed to monitor groundwater quality upgradient and downgradient of the Ash Pond were decommissioned in 2017.

§257.90(e)(3) SUMMARY OF GROUNDWATER ANALYSIS

§257.90(e)(3) In addition to all the monitoring data obtained under §257.90 through §257.98, a summary including the number of groundwater samples that were collected for analysis for each background [upgradient] and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;

In accordance with §257.94(b), a minimum of eight independent samples from each upgradient and downgradient monitoring well were collected prior to October 17, 2017. A summary of the groundwater monitoring program for the Ash pond, including the analytical results for the Appendix III and Appendix IV list of constituents, is presented in **Table 2** of this report. All the samples obtained were required by the detection monitoring program.

§257.90(e)(4) CURRENT GROUNDWATER MONITORING PROGRAM

§257.90(e)(4) A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels);

Consistent with §257.90(e), the 2017 annual report documents groundwater related activities conducted during the prior calendar year at the Ash pond. The statistical analysis of the initial minimum eight rounds of groundwater sampling was completed by January 15, 2018 as required. This statistical analysis relied on the use of tolerance intervals as originally certified on October 17, 2017. The results of this statistical analysis identified statistically significant increases (SSI) of Appendix III constituents in one or more wells monitoring the uppermost aquifer downgradient of the Ash pond. Consistent with §257.94(e)(2), SIGECO is evaluating options to demonstrate that a source other than the CCR unit caused the SSI and will provide a narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels), as appropriate, in subsequent annual reports.

§257.90(e)(5) OTHER REQUIRED INFORMATION

§257.90(e)(5) Other information required to be included in the annual report as specified in §257.90 through §257.98.

This initial Annual Report documents activities conducted to comply with Sections §257.90 through §257.94 of the Rule. There are no applicable requirements from Sections §257.95 through §257.98.

Attachments

Table 1. Groundwater Monitoring Well Location and Construction Details

Table 2. Summary of Analytical Results

Figure 1. Monitoring Well Network

\\\haleyaldrich.com\\share\\grn_common\\129420 Vectren\\AB Brown\\Annual Report\\Ash Pond\\Text\\ABB_AP_Annual_GW_Report_F.docx

TABLES

TABLE I

Page 1 of 1

GROUNDWATER MONITORING WELL LOCATION AND CONSTRUCTION DETAILS

A.B. BROWN GENERATING STATION ASH POND

MOUNT VERNON, INDIANA

Well	CCR Unit	Date Installed	Easting	Northing	Top of Pad Elevation (ft msl)	Top of Riser Elevation (ft msl)	Surface Grout (ft bgs)	Bentonite (ft bgs)	Sand Pack (ft bgs)	Screen Zone (ft bgs)	Screen Length (ft)	Well Radius (in)
CCR-AP-1R	Ash Pond	July 2016	2773560.71	968260.82	464.70	467.57	0.0 - 23.0	23.0 - 25.0	25.0 - 37.0	27.0 - 37.0	10	2.00
CCR-AP-2R	Ash Pond	July 2016	2771922.52	969079.16	465.40	468.13	0.0 - 39.0	39.0 - 41.0	41.0 - 53.3	43.3 - 53.3	10	2.00
CCR-AP-3R	Ash Pond	July 2016	2771404.27	966865.12	450.10	449.13	0.0 - 33.0	33.0 - 35.0	35.0 - 47.0	37.0 - 47.0	10	2.00
CCR-AP-4R	Ash Pond	July 2016	2772827.01	966741.47	472.80	475.38	0.0 - 34.0	34.0 - 36.0	36.0 - 48.0	38.0 - 48.0	10	2.00
CCR-AP-5	Ash Pond	March 2016	2771019.70	968166.03	451.00	453.77	0.0 - 31.0	31.0 - 33.0	33.0 - 45.0	35.0 - 45.0	10	2.00
CCR-AP-6	Ash Pond	March 2016	2771626.75	969932.76	458.90	461.57	0.0 - 25.0	25.0 - 27.0	27.0 - 39.0	29.0 - 39.0	10	2.00
CCR-AP-7R	Ash Pond	July 2016	2773501.63	970758.70	486.00	488.57	0.0 - 39.5	39.5 - 41.5	41.5 - 53.5	43.5 - 53.5	10	2.00
CCR-BK-1R	Background	March 2016	2770919.08	974083.40	480.10	483.39	0.0 - 50.0	50.0 - 52.0	52.0 - 64.0	54.0 - 64.0	10	2.00
CCR-BK-2	Background	March 2016	2769728.14	972854.33	427.50	430.60	0.0 - 11.5	11.5 - 13.5	13.5 - 25.5	15.5 - 25.5	10	2.00

Notes:

bgs = below ground surface

ft = feet

in = inches

msl = mean sea level

Datum of Elevations in NAVD 88

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Upgradient									CCR-BK-1R CCR-BK-1R-20171116
	CCR-BK-1R CCR-BK-1-20160811	CCR-BK-1R CCR-BK-1-20161027	CCR-BK-1R CCR-BK-1R-20161107	CCR-BK-1R CCR-BK-1R-20161206	CCR-BK-1R CCR-BK-1R-20170207	CCR-BK-1R CCR-BK-1R-20170407	CCR-BK-1R CCR-BK-1R-20170606	CCR-BK-1R CCR-BK-1R-20170928		
Location Name										
Sample Name										
Sample Date	08/11/2016	10/27/2016	11/07/2016	12/06/2016	02/07/2017	04/07/2017	06/06/2017	09/28/2017		
Lab Sample ID	180-57528-14	180-60271-6	180-60609-5	180-61491-18	180-63324-18	180-65040-1	180-67229-16	180-70809-15		
Water Level (ft amsl)	463.50	422.65	423.39	422.39	421.39	425.39	425.39	425.39		
Monitoring Program	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline		Detection
Field Parameters										
Temperature (Deg C)	20.68	15.88	20.42	11.36	14.52	14.94	17.06	24.01		10.95
Turbidity, Field (NTU)	-	-	-	-	-	-	-	0.76		-
Dissolved Oxygen, Field (mg/L)	5.15	5.85	5.89	7.03	5.98	5.43	6.28	6		8.82
Conductivity, Field (mS/cm)	0.3475	0.38255	0.36566	0.32748	0.3703	0.31348	0.35539	0.35718		0.40797
ORP, Field (mv)	222	223.99	116.48	52.8	131.91	98.13	266.28	147.09		47.02
Turbidity, Field (NTU)	17.39	19.19	10.68	97.13	6.47	17.2	24.08	-		131.33
pH, Field (su)	6.8	6.95	7.02	7.14	6.87	7.22	6.95	6.88		7.13
Detection Monitoring - EPA Appendix III Constituents (mg/L)										
Boron, Total	0.014 U	0.02 U	0.023 U	0.02 U	0.08 U	0.019 J	0.026 J	0.015 J+		0.041 J
Calcium, Total	36	41	38	36	34	35	34	35		39
Chloride (mg/L)	R	2.4	1.5	2.3	2.3	2.7	2.1	2.2		2.6
Fluoride (mg/L)	R	0.35	0.32	0.35	0.3	0.38	0.3	0.35 J+		0.3
Sulfate (mg/L)	R	26	21	26	27	28	25	25		26 J-
pH (lab) (su)	7.4 J	7.5 J	7 J	6.9 J	7.2 J	7.2 J	7.1 J	7.1 J		7.8 J
Total Dissolved Solids (TDS) (mg/L)	220	210	220	200	230	250	270	210		210
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)										
Antimony, Total	0.002 U	0.002 U	0.00056 J	0.002 U		0.00045 J				
Arsenic, Total	0.0011	0.00021 J	0.001 U	0.00031 J	0.00094 J	0.00095 J	0.00047 J	0.0025 J+		0.0015 J+
Barium, Total	0.048	0.035	0.037 J-	0.031 J-	0.038	0.04	0.038	0.032 J-		0.082 J-
Beryllium, Total	0.00012 J	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U		0.001 U
Cadmium, Total	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U		0.001 U
Chromium, Total	0.0025	0.00046 J	0.00087 J	0.00071 J	0.003	0.0026	0.0019 J	R		0.0027 J+
Cobalt, Total	0.0028	0.00076	0.00051	0.0005 U	0.0011	0.001	0.00062	R		0.0022
Lead, Total	0.00082 J	0.00024 J	0.000079 J	0.000096 J	0.00099 J	0.00092 J	0.00052 J	0.001 U		0.0008 J
Lithium, Total	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		0.0086 J
Molybdenum, Total	0.0025 J	0.005 U	0.005 U	0.0015 J	0.0017 J	0.0025 J	0.0015 J	R		0.0034 J
Selenium, Total	0.00067 J	0.005 U	0.00037 J	0.00051 J	0.005 U	0.005 U	0.005 U	0.005 U		0.005 U
Thallium, Total	0.000038 J	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U		0.001 U
Mercury, Total	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U		0.0002 U
Fluoride (mg/L)	R	0.35	0.32	0.35	0.3	0.38	0.3	0.35 J+		0.3
Radiological (pCi/L)										
Radium-226	0.0484 U ± 0.104	0.0760 U ± 0.210	R	0.303 U ± 0.296	0.142 ± 0.0913	0.280 ± 0.0981	0.177 J ± 0.0924	R		0.165 ± 0.0740
Radium-228	0.0724 UJ ± 0.514	0.191 U ± 0.217	-0.0566 U ± 0.222	0.179 U ± 0.238	-0.0934 U ± 0.194	0.177 U ± 0.257	0.337 ± 0.257	0.171 U ± 0.226		0.388 U ± 0.268
Radium-226 & 228	0.121 UJ ± 0.525	0.267 U ± 0.302	R	0.482 ± 0.380	0.142 U ± 0.214	0.457 J ± 0.275	0.515 J ± 0.273	0.426 J ± 0.243		0.553 J ± 0.278

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals
 CFR: Code of Federal Regulations
 ft amsl: feet above mean sea level
 MCL: Maximum Contaminant Level
 mg/L: milligram per liter
 mS/cm: millisiemen per centimeter
 mv: millivolt
 NA: Not Applicable
 NTU: Nephelometric Turbidity Units
 pCi/L: picoCurie per liter
 su: standard units
 USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated
 J+: value is estimated with a potentially high bias
 J-: value is estimated with a potentially low bias
 R: value is rejected
 U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Upgradient								
	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2	CCR-BK-2
Location Name	CCR-BK-2-20160608	CCR-BK-2-20160810	CCR-BK-2-20161027	CCR-BK-2-20161206	CCR-BK-2-20170210	CCR-BK-2-20170405	CCR-BK-2-20170606	CCR-BK-2-20170927	CCR-BK-2-20171116
Sample Name	06/08/2016	08/10/2016	10/27/2016	12/06/2016	02/10/2017	04/05/2017	06/06/2017	09/27/2017	11/16/2017
Sample Date	180-55607-6	180-57528-15	180-60271-7	180-61491-19	180-63446-1	180-64974-1	180-67229-17	180-70809-16	180-72643-22
Lab Sample ID	416.46	412.21	408.69	407.90	412.89	413.71	413.94	412.64	406.12
Water Level (ft amsl)	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Detection
Monitoring Program									
Field Parameters									
Temperature (Deg C)	17.51	17.4	15.98	14.25	13.49	15.79	15.68	16.85	14.23
Turbidity, Field (NTU)	-	-	-	-	-	-	-	167.49	-
Dissolved Oxygen, Field (mg/L)	0.42	0.22	0.38	0.33	0.35	1.08	0.14	0.43	0.47
Conductivity, Field (mS/cm)	0.6551	0.4173	0.40128	0.30961	0.38131	0.29739	0.41407	0.38594	0.38795
ORP, Field (mv)	28.72	144	234.6	87.3	120.09	200.74	212.67	212.04	108.47
Turbidity, Field (NTU)	17.85	1.751	858.51	336.44	11.66	-22.18	-1.12	-	181.78
pH, Field (su)	6.98	6.64	6.7	6.19	6.72	6.66	6.67	6.64	6.74
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	0.018 J+	0.014 U	0.02 U	0.02 U	0.08 U	0.016 U	0.021 J	0.018 J+	0.02 J
Calcium, Total	53	39	46	36	34	45	37	37	35
Chloride (mg/L)	12	17	17	19	12 J+	19	14	19	19
Fluoride (mg/L)	R	0.14 J+	0.16	0.2 J+	0.14	0.16	0.13	R	0.13
Sulfate (mg/L)	61	30 J-	28	26	25 J+	29	27	24	23 J-
pH (lab) (su)	7.09 J	7.1 J	6.8 J	6.7 J	8.5 J	7.2 J	7 J	6.8 J	7.3 J
Total Dissolved Solids (TDS) (mg/L)	360	260	350	260	230	240	270	320	250
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.002 U	0.002 U	0.00048 J				
Arsenic, Total	0.00032 J	0.001 U	0.0013	0.00051 J	0.00031 J	0.001 U	0.001 U	0.0035 J+	0.0028
Barium, Total	0.041 J-	0.033	0.15	0.036 J-	0.033 J-	0.034 J-	0.035	0.048 J-	0.046 J-
Beryllium, Total	0.001 U	0.001 U	0.0004 J	0.001 U	0.001 U	0.001 U	0.001 U	0.00018 J	0.001 U
Cadmium, Total	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U				
Chromium, Total	0.002 U	0.002 U	0.0047	0.00076 J	0.002 UJ	0.002 U	0.002 U	R	0.0043 J+
Cobalt, Total	0.000096 J	0.0001 J	0.0062	0.0005 U	0.0005 U	0.0005 U	0.0005 U	0.0015 J+	0.0012
Lead, Total	0.000028 J	0.001 U	0.011	0.00057 J	0.001 U	0.001 U	0.001 U	0.0028 J+	0.0024
Lithium, Total	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U				
Molybdenum, Total	0.0017 J	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.00062 J	0.005 U	0.00068 J
Selenium, Total	0.005 U	0.005 U	0.0098 J	0.00047 J	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.001 U	0.001 U	0.001 U	0.0001 U	0.000059 J				
Mercury, Total	0.0002 UJ	0.0002 U	0.0001 J	0.0002 UJ	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 UJ
Fluoride (mg/L)	R	0.14 J+	0.16	0.2 J+	0.14	0.16	0.13	R	0.13
Radiological (pCi/L)									
Radium-226	0.102 J ± 0.0557	0.0387 U ± 0.0693	1.14 J ± 0.720	0.346 U ± 0.284	0.0539 UJ ± 0.0753	0.0198 U ± 0.0619	0.00911 UJ ± 0.0490	R	0.149 ± 0.0943
Radium-228	0.0185 U ± 0.200	0.0797 UJ ± 0.324	0.764 U ± 0.727	R	0.163 U ± 0.253	0.102 U ± 0.198	0.144 ± 0.284	0.279 U ± 0.416	2.98 ± 0.579
Radium-226 & 228	0.120 U ± 0.207	0.118 UJ ± 0.331	1.91 J ± 1.02	0.796 J ± 0.380	0.217 UJ ± 0.264	0.122 UJ ± 0.208	0.153 UJ ± 0.288	0.525 UJ ± 0.436	3.13 ± 0.587

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals

CFR: Code of Federal Regulations

ft amsl: feet above mean sea level

MCL: Maximum Contaminant Level

mg/L: milligram per liter

mS/cm: millisiemen per centimeter

mV: millivolt

NA: Not Applicable

NTU: Nephelometric Turbidity Units

pCi/L: picoCurie per liter

su: standard units

USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated

J+: value is estimated with a potentially high bias

J-: value is estimated with a potentially low bias

R: value is rejected

U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient								
	CCR-AP-1R CCR-AP-1-20160607 06/07/2016 180-55566-3 457.99 Baseline	CCR-AP-1R CCR-AP-1-20160810 08/10/2016 180-57528-16 457.78 Baseline	CCR-AP-1R CCR-AP-1-20161026 10/26/2016 180-60193-1 451.26 Baseline	CCR-AP-1R CCR-AP-1-20161205 12/05/2016 180-61491-1 450.94 Baseline	CCR-AP-1R CCR-AP-1-20170206 02/06/2017 180-63324-4 451.51 Baseline	CCR-AP-1R CCR-AP-1-20170404 04/04/2017 180-64974-2 450.75 Baseline	CCR-AP-1R CCR-AP-1-20170605 06/05/2017 180-67229-1 449.88 Baseline	CCR-AP-1R CCR-AP-1-20170926 09/26/2017 180-70809-1 448.78 Baseline	CCR-AP-1R CCR-AP-1-20171114 11/14/2017 180-72643-14 451.72 Detection
Field Parameters									
Temperature (Deg C)	19.22	20.4	17.85	14.6	13.31	17.97	16.45	16.88	15.21
Turbidity, Field (FNU)	-			-			-	72.64	
Dissolved Oxygen, Field (mg/L)	7.03	0.14	0.17	0.17	5.67	0.32	0.03	0.01	0.02
Conductivity, Field (mS/cm)	2.00099	7.41	7.48293	4.554	0.98911	4.76554	5.6183	5.10195	5.2188
ORP, Field (mv)	-13.54	88	200.43	99.2	126.78	190.47	224.98	420.3	115.65
Turbidity, Field (NTU)	41.73	28.41	-1.47	573.87	24.67	604.32	-1.78	-	117.39
pH, Field (su)	6.47	6.67	6.73	6.57	6.98	6.63	6.75	6.81	6.73
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	2.2	9.5	9.5	9.8	12	9.5	11	7.5 J+	7.6
Calcium, Total	41	480	530	420	370	420	320	230	270
Chloride (mg/L)	110	670	840	740	700	640	520	390	430
Fluoride (mg/L)	0.22	0.5 U	5 U	0.73	0.5 U	0.25 J	0.41 J	0.46 J+	0.2 J
Sulfate (mg/L)	460	2700 J-	3500 J-	3200	3700	2800	2300	2100	2100 J-
pH (lab) (su)	6.51 J	7 J	6.8 J	6.8 J	7.2 J	7 J	7.2 J	7 J	7.8 J
Total Dissolved Solids (TDS) (mg/L)	1100	6500	6800	6400	6600	5600	5100	4000	4200
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.0052	0.0012 J+	0.0008 J	0.00039 J	0.001 U	0.00033 J	0.00031 J	R	0.001 U
Barium, Total	0.041	0.022	0.018 J-	0.018 J-	0.049	0.017 J-	0.016	0.012 J-	0.017 J-
Beryllium, Total	0.000065 J	0.001 U	0.00019 J	0.00019 J	0.001 U				
Cadmium, Total	0.001 U	0.00028 J	0.00017 J	0.00016 J	0.0008 J	0.001 U	0.001 U	0.001 U	0.001 U
Chromium, Total	0.0011 J	0.002 U	0.002 U	0.002 U	0.00087 J	0.002 U	0.002 U	0.002 UJ	0.002 U
Cobalt, Total	0.011	0.0077	0.0025	0.0019	0.003	0.00071	0.0006	0.00042 J	0.00084
Lead, Total	0.0013	0.00031 J	0.00015 J	0.001 U					
Lithium, Total	0.012 J	0.0099 J	0.016 J	0.015 J	0.066	0.05 U	0.05 U	0.05 U	0.05 U
Molybdenum, Total	0.005	0.0049 J	0.0031 J	0.0039 J	1.6	0.0024 J	0.0032 J	0.0024 J	0.0036 J
Selenium, Total	0.005 U	0.00049 J	0.005 U						
Thallium, Total	0.000038 J	0.000075 J	0.00013 J	0.001 U					
Mercury, Total	0.0002 U	0.0002 U	0.0002 UJ	0.0002 U					
Fluoride (mg/L)	0.22	0.5 U	5 U	0.73	0.5 U	0.25 J	0.41 J	0.45 J+	0.2 J
Radiological (pCi/L)									
Radium-226	0.0602 U ± 0.0870	0.411 ± 0.108	0.717 ± 0.337	R	0.292 ± 0.120	0.193 ± 0.0909	0.211 J ± 0.0870	R	0.256 ± 0.0859
Radium-228	0.229 U ± 0.397	0.300 UJ ± 0.262	0.320 U ± 0.247	0.493 ± 0.246	0.513 ± 0.252	0.391 ± 0.255	0.247 U ± 0.265	0.673 ± 0.280	0.594 ± 0.243
Radium-226 & 228	0.289 U ± 0.406	0.711 J ± 0.284	1.04 J ± 0.418	R	0.805 ± 0.279	0.583 ± 0.270	0.458 J ± 0.278	1.05 J ± 0.303	0.849 ± 0.258

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals

CFR: Code of Federal Regulations

ft amsl: feet above mean sea level

MCL: Maximum Contaminant Level

mg/L: milligram per liter

mS/cm: millisiemen per centimeter

mV: millivolt

NA: Not Applicable

NTU: Nephelometric Turbidity Units

pCi/L: picoCurie per liter

su: standard units

USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated

J+: value is estimated with a potentially high bias

J-: value is estimated with a potentially low bias

R: value is rejected

U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient									
	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R	CCR-AP-2R
Location Name	CCR-AP-2-20160811	CCR-AP-2-20161025	CCR-AP-2R-20161107	CCR-AP-2R-20161206	CCR-AP-2R-20170207	CCR-AP-2R-20170404	CCR-AP-2R-20170606	CCR-AP-2R-20170927	CCR-AP-2R-20171115	
Sample Name	08/11/2016		10/25/2016		11/07/2016		02/07/2017		04/04/2017	
Sample Date	180-57528-17		180-60160-5		180-60609-1		180-61491-2		180-63324-2	
Lab Sample ID	441.66		435.66		435.24		436.03		435.12	
Water Level (ft amsl)	Baseline		Baseline		Baseline		Baseline		Baseline	
Monitoring Program										
Field Parameters										
Temperature (Deg C)	19.8	19.46	20.24	14.47	16.1	19.54	18.76	19.71	16.19	
Turbidity, Field (NTU)	-	-	-	-	-	-	-	-11.22		
Dissolved Oxygen, Field (mg/L)	1.25	0.68	0.69	0.72	0.53	0.69	0.23	0.25	0.27	
Conductivity, Field (mS/cm)	8.151	8.54406	5.18532	6.975	7.58134	5.4526	8.67183	8.90809	8.01588	
ORP, Field (mv)	189	145.29	107.1	115	115.79	187.26	167.33	358.49	123.91	
Turbidity, Field (NTU)	756.5	15.14	17.82	20.32	12.2	-15.03	5.16	-	0.74	
pH, Field (su)	7.11	7.03	6.99	6.82	6.87	6.91	6.94	6.96	6.83	
Detection Monitoring - EPA Appendix III Constituents (mg/L)										
Boron, Total	12	14	15	15	9.9	12	12	12 J+	12	
Calcium, Total	290	370	380	360	430	390	410	350	350	
Chloride (mg/L)	R	870	810	710	670	920	850	790	760	
Fluoride (mg/L)	0.5 U	0.58 J	0.5 J	0.7	0.5 U	0.9	0.51 J	0.5 J+	0.27 J	
Sulfate (mg/L)	R	3800	3700	3800	3100	4400	4200	4100	3900 J-	
pH (lab) (su)	7.4 J	7.2 J	7 J	7 J	6.9 J	7.1 J	7.2 J	7.1 J	7.5 J	
Total Dissolved Solids (TDS) (mg/L)	6800	8500	7200	6300	5700	7100	8000	7200	6000	
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)										
Antimony, Total	0.002 U	0.02 U	0.00011 J	0.002 U						
Arsenic, Total	0.024	0.01 U	0.0011 J+	0.00071 J	0.001 U	0.00043 J	0.00034 J	R	0.001 U	
Barium, Total	0.041	0.035 J	0.037 J-	0.051 J-	0.019	0.045 J-	0.046	0.035 J-	0.043 J-	
Beryllium, Total	0.0027 J	0.01 U	0.001 U	0.0002 J	0.001 U	0.00015 J	0.001 U	0.00013 J	0.001 U	
Cadmium, Total	0.0003 J	0.01 U	0.00056 J	0.00031 J	0.00019 J	0.0003 J	0.00032 J	0.00063 J	0.00038 J	
Chromium, Total	0.0036	0.02 U	0.00071 J	0.002 U						
Cobalt, Total	0.0079	0.0022 J	0.0025	0.0032	0.0012	0.0021	0.0023	0.0019 J+	0.0026	
Lead, Total	0.0052 J	0.01 U	0.00019 J	0.000083 J	0.001 U					
Lithium, Total	0.054	0.06	0.062	0.067	0.011 J	0.056	0.061	0.062	0.058	
Molybdenum, Total	1.2	1.6	1.8	1.5	0.005 U	1.4	1.5	1.6	1.7	
Selenium, Total	0.00079 J	0.05 U	0.00042 J	0.0004 J	0.005 U					
Thallium, Total	0.000041 J	0.01 U	0.00015 J	0.0001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	
Mercury, Total	0.0002 U	0.0002 U	0.0002 U	0.0002 UJ	0.00008 J	0.0002 U	0.0002 U	0.0002 U	0.0002 U	
Fluoride (mg/L)	0.5 U	0.58 J	0.5 J	0.7	0.5 U	0.9	0.51 J	0.5 J+	0.27 J	
Radiological (pCi/L)										
Radium-226	0.703 ± 0.205	0.434 J ± 0.280	0.261 U ± 0.223	0.0875 U ± 0.213	0.188 ± 0.108	0.141 ± 0.0848	0.233 J ± 0.0901	0.409 J ± 0.118	0.217 ± 0.0813	
Radium-228	0.675 U ± 0.622	0.352 U ± 0.249	0.394 ± 0.241	0.647 ± 0.271	0.373 ± 0.236	0.291 U ± 0.229	0.403 ± 0.224	R	0.620 ± 0.256	
Radium-226 & 228	1.38 J ± 0.655	0.786 J ± 0.374	R	R	0.562 ± 0.259	0.432 J ± 0.244	0.636 ± 0.241	1.09 J ± 0.311	0.837 ± 0.269	

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals

CFR: Code of Federal Regulations

ft amsl: feet above mean sea level

MCL: Maximum Contaminant Level

mg/L: milligram per liter

mS/cm: millisiemen per centimeter

mV: millivolt

NA: Not Applicable

NTU: Nephelometric Turbidity Units

pCi/L: picoCurie per liter

su: standard units

USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated

J+: value is estimated with a potentially high bias

J-: value is estimated with a potentially low bias

R: value is rejected

U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient								
	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R	CCR-AP-3R
Location Name	CCR-AP-3-20160815	CCR-AP-3-20161027	CCR-AP-3R-20161108	CCR-AP-3R-20161206	CCR-AP-3R-20170207	CCR-AP-3R-20170405	CCR-AP-3R-20170606	CCR-AP-3R-20170927	CCR-AP-3R-20171115
Sample Name	08/15/2016	10/27/2016	11/08/2016	12/06/2016	02/07/2017	04/05/2017	06/06/2017	09/27/2017	11/15/2017
Sample Date	180-57626-1	180-60271-4	180-60609-2	180-61491-3	180-63324-3	180-64974-4	180-67229-3	180-70809-3	180-72643-16
Lab Sample ID	427.18	411.89	409.39	413.95	410.28	408.61	408.56	410.77	409.86
Water Level (ft amsl)	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Detection
Monitoring Program									
Field Parameters									
Temperature (Deg C)	19.68	17.53	18.16	16.4	17.21	18.78	18.62	19.96	17.14
Turbidity, Field (FNU)	-	-	-	-	-	-	-	-11.22	-
Dissolved Oxygen, Field (mg/L)	0.65	0.38	0.97	0.26	0.17	0.7	0.12	0.07	0.08
Conductivity, Field (mS/cm)	7.828	8.67638	8.57001	8.645	8.63738	6.66285	9.48072	10.426	10.517
ORP, Field (mv)	48	217.95	152.88	131.8	117.35	189.49	179.62	232.4	126.38
Turbidity, Field (NTU)	10.41	4.28	4.38	0	-1.71	-22.88	-3.07	-	-0.87
pH, Field (su)	7.25	7.04	7.17	6.91	6.9	6.96	7	7.01	6.97
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	11	14	13	15	11	16	12	14 J+	13
Calcium, Total	260	380	370	380	400	450	480	420	420
Chloride (mg/L)	730	900	860	880	820	1500 J	990	930	980
Fluoride (mg/L)	0.95	0.96 J	0.96 J	1.1	0.82 J+	1.1	0.87 J	1 J+	0.72 J
Sulfate (mg/L)	3000	3400	3500	3900	3700	6900 J	4400	4900	5300 J-
pH (lab) (su)	7.4 J	7.2 J	7 J	7 J	7.1 J	7 J	7.3 J	7.1 J	7.5 J
Total Dissolved Solids (TDS) (mg/L)	6200	7000	6900	7100	7100	7800	8500	8500	8000
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.00022 U	0.02 U	0.00092 J	0.002 U					
Arsenic, Total	0.00044 J	0.01 U	0.001 U	0.00036 J	0.001 U	0.00029 J	0.001 U	R	0.001 U
Barium, Total	0.015	0.016 J	0.02 J-	0.024 J-	0.017	0.017 J-	0.017	0.016 J-	0.017 J-
Beryllium, Total	0.001 U	0.01 U	0.001 U	0.00021 J	0.001 U	0.00017 J	0.001 U	0.001 U	0.001 U
Cadmium, Total	0.00017 J	0.01 U	0.00024 J	0.0003 J	0.0002 J	0.00013 J	0.00018 J	0.00029 J	0.0002 J
Chromium, Total	0.0008 J	0.02 U	0.00085 J	0.00051 J	0.002 U	0.002 U	0.002 U	0.002 UJ	0.002 U
Cobalt, Total	0.00035 J	0.005 U	0.00011 J	0.0005 U	0.00017 J	0.0005 U	0.00015 J	R	0.00021 J
Lead, Total	0.00028 J	0.01 U	0.001 U	0.00014 J	0.001 U				
Lithium, Total	0.071	0.077	0.083	0.08	0.065	0.062	0.077	0.087	0.09
Molybdenum, Total	0.94	0.91	1	0.93	0.72	0.74	0.82	0.81	0.86
Selenium, Total	0.021	0.017 J	0.024	0.016	0.0041 J	0.0017 J	0.0028 J	0.0043 J+	0.0031 J
Thallium, Total	0.001 U	0.01 U	0.00014 J	0.001 U					
Mercury, Total	0.000071 J	0.000082 J	0.0002 U	0.000094 J-	0.00053	0.00012 J	0.000085 J	0.00018 J	0.00016 J-
Fluoride (mg/L)	0.95	0.96 J	0.96 J	1.1	0.82 J+	1.1	0.87 J	1 J+	0.72 J
Radiological (pCi/L)									
Radium-226	0.199 ± 0.0723	0.173 U ± 0.202	R	0.0963 U ± 0.229	0.172 ± 0.104	0.0894 U ± 0.0714	0.116 J ± 0.0696	R	0.138 ± 0.0700
Radium-228	0.523 ± 0.314	0.431 ± 0.281	0.162 U ± 0.254	1.06 ± 0.285	0.393 U ± 0.263	0.429 ± 0.253	0.367 U ± 0.248	R	0.509 ± 0.277
Radium-226 & 228	0.722 ± 0.322	0.603 J ± 0.346	R	R	0.565 J ± 0.283	0.518 J ± 0.263	0.484 J ± 0.257	1.24 J+ ± 0.320	0.647 ± 0.286

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals
 CFR: Code of Federal Regulations
 ft amsl: feet above mean sea level
 MCL: Maximum Contaminant Level
 mg/L: milligram per liter
 mS/cm: millisiemen per centimeter
 mv: millivolt
 NA: Not Applicable
 NTU: Nephelometric Turbidity Units
 pCi/L: picoCurie per liter
 su: standard units
 USEPA: United States Environmental Protection Agency

QUALIFIERS:
 J: value is estimated
 J+: value is estimated with a potentially high bias
 J-: value is estimated with a potentially low bias
 R: value is rejected
 U: Not detected value is the laboratory reporting limit
 - USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.
<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient								
	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R	CCR-AP-4R
Location Name	CCR-AP-4-20160607	CCR-AP-4-20160811	CCR-AP-4-20161026	CCR-AP-4R-20161205	CCR-AP-4R-20170206	CCR-AP-4R-20170425	CCR-AP-4R-20170605	CCR-AP-4R-20170926	CCR-AP-4R-20171114
Sample Name	06/07/2016	08/11/2016	10/26/2016	12/05/2016	02/06/2017	04/25/2017	06/05/2017	09/26/2017	11/14/2017
Sample Date	180-55566-2	180-57528-18	180-60193-2	180-61491-4	180-63324-1	180-65681-1	180-67229-4	180-70809-4	180-72643-17
Lab Sample ID	444.60	441.50	439.76	440.62	440.39	-	440.65	439.72	439.49
Water Level (ft amsl)	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Detection
Monitoring Program									
Field Parameters									
Temperature (Deg C)	14.77	21.89	14.98	12.35	15.08	14.55	16.87	16.55	13.58
Turbidity, Field (NTU)	-	-	-	-	-	-	-	74.75	-
Dissolved Oxygen, Field (mg/L)	4.6	6.51	4.79	6.91	0.1	6.18	5.93	6.64	6.23
Conductivity, Field (mS/cm)	1.98612	1.891	1.8735	2.92	6.67429	1.01	1.35109	1.05291	1.06282
ORP, Field (mv)	86.77	105	226.69	107.6	114.16	259	210.43	154.14	135.88
Turbidity, Field (NTU)	2.16	48.15	9.75	441.79	34.52	150.4	-1.82	-	329.8
pH, Field (su)	7.06	7.03	6.98	6.9	6.71	6.97	6.92	6.98	6.89
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	0.018	0.089 J+	0.045 J+	0.13 J+	0.16	0.21	0.2	0.23 J+	0.15
Calcium, Total	210	180	210	130	110	110	160	110	110
Chloride (mg/L)	48	R	79	34	23	21	30	20	22
Fluoride (mg/L)	0.44	0.41	0.4	0.48	0.33 J+	0.41	0.39	0.39 J+	0.41
Sulfate (mg/L)	220	R	150 J-	86	97	130	96	120	140 J-
pH (lab) (su)	6.97 J	7.3 J	7.1 J	7.1 J	7.3 J	7.5 J	7.3 J	7.3 J	7.7 J
Total Dissolved Solids (TDS) (mg/L)	1300	1200	1300	710	630	640	930	650	650
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.00029 J	0.00059 J	0.00032 J	0.00032 J	0.001 U	0.0003 J	0.00026 J	R	0.001 U
Barium, Total	0.12	0.089	0.11 J-	0.063 J-	0.051	0.043	0.069	0.042 J-	0.045 J-
Beryllium, Total	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Cadmium, Total	0.00022	0.00018 J	0.0001 U	0.0001 U	0.000084 J	0.0001 U	0.0001 U	0.0001 U	0.0001 U
Chromium, Total	0.00022	0.0016 J	0.0022	0.0018 J	0.0015 J	0.0018 J	0.0022	R	0.0027 J+
Cobalt, Total	0.00026 J	0.0033	0.00081	0.0005 U	0.0002 J	0.00011 J	0.0005 U	0.0005 U	0.0003 J
Lead, Total	0.000085 J	0.00023 J	0.00017 J	0.00009 J	0.0001 U	0.001 U	0.001 U	0.001 U	0.001 U
Lithium, Total	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U
Molybdenum, Total	0.0016 J	0.0088	0.0033 J	0.0046 J	0.005 U	0.0019 J	0.0028 J	0.002 J	0.0017 J
Selenium, Total	0.005 U	0.001 J	0.00057 J+	0.00051 J	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.000021 J	0.001 U	0.001 U	0.001 U	0.00022 J	0.001 U	0.001 U	0.001 U	0.001 U
Mercury, Total	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U
Fluoride (mg/L)	0.44	0.41	0.4	0.48	0.33 J+	0.41	0.39	0.39 J+	0.41
Radiological (pCi/L)									
Radium-226	0.157 ± 0.0919	0.327 ± 0.108	0.116 U ± 0.206	R	0.0779 U ± 0.0791	0.126 U ± 0.0996	0.185 J ± 0.0926	R	0.159 ± 0.0794
Radium-228	0.127 U ± 0.259	7.60 J ± 1.03	0.369 U ± 0.307	0.370 ± 0.239	0.199 U ± 0.251	-0.0800 U ± 0.296	0.144 U ± 0.215	-0.0756 U ± 0.212	0.488 ± 0.307
Radium-226 & 228	0.285 U ± 0.275	7.93 J ± 1.04	0.485 U ± 0.370	R	0.277 U ± 0.263	0.126 U ± 0.313	0.329 UJ ± 0.234	0.11 UJ ± 0.223	0.647 ± 0.317

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals

CFR: Code of Federal Regulations

ft amsl: feet above mean sea level

MCL: Maximum Contaminant Level

mg/L: milligram per liter

mS/cm: millisiemen per centimeter

mV: millivolt

NA: Not Applicable

NTU: Nephelometric Turbidity Units

pCi/L: picoCurie per liter

su: standard units

USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated

J+: value is estimated with a potentially high bias

J-: value is estimated with a potentially low bias

R: value is rejected

U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient								
	CCR-AP-5 CCR-AP-5-20160606 06/06/2016 180-55566-1 415.47 Baseline	CCR-AP-5 CCR-AP-5-20160811 08/11/2016 180-57528-19 415.79 Baseline	CCR-AP-5 CCR-AP-5-20161027 10/27/2016 180-60271-5 415.43 Baseline	CCR-AP-5 CCR-AP-5-20161206 12/06/2016 180-61491-5 415.67 Baseline	CCR-AP-5 CCR-AP-5-20170207 02/07/2017 180-63324-5 416.24 Baseline	CCR-AP-5 CCR-AP-5-20170405 04/05/2017 180-64974-5 416.25 Baseline	CCR-AP-5 CCR-AP-5-20170606 06/06/2017 180-67229-5 416.06 Baseline	CCR-AP-5 CCR-AP-5-20170927 09/27/2017 180-70809-5 416.61 Baseline	CCR-AP-5 CCR-AP-5-20171115 11/15/2017 180-72643-18 417.07 Detection
Field Parameters									
Temperature (Deg C)	19.24	22.87	16.36	13.43	16.93	18.87	17.69	19.05	15.34
Turbidity, Field (FNU)	-	-	-	-	-	-	-	-11.22	-
Dissolved Oxygen, Field (mg/L)	0.28	0.66	0.51	0.26	0.24	0.2	0.06	0.06	0.07
Conductivity, Field (mS/cm)	5.99649	6.133	4.98392	5.8693	5.87591	4.20036	5.60685	5.99388	5.89855
ORP, Field (mv)	8.67	209	30	120.8	91.74	126.06	210.99	461.25	108.88
Turbidity, Field (NTU)	10.35	4.789	7.46	0	0.17	-20.21	-2.99	-	332.69
pH, Field (su)	7	6.89	7.12	6.95	6.97	7.01	7.02	7.02	6.99
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	11	11	10	12	11	11	12	9.3 J+	11
Calcium, Total	300	310	350	350	330	360	340	300	310
Chloride (mg/L)	380	R	380	380	370	370	380	350	360
Fluoride (mg/L)	0.26 J	0.5 U	0.31 J	0.54	0.5 U	0.23 J	0.34 J	0.2 J+	0.32 J
Sulfate (mg/L)	2900	R	2600	3000	3000	3100	2700	3000	3100 J-
pH (lab) (su)	7.05 J	7.4 J	7.2 J	7.1 J	7.2 J	7.2 J	7.2 J	7.1 J	8 J
Total Dissolved Solids (TDS) (mg/L)	5000	5100	5000	5000	5300	4900	5000	4900	4800
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.02 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.00057 J	0.0003 J	0.01 U	0.00016 J	0.001 U				
Barium, Total	0.019	0.016	0.015 J	0.016 J-	0.016	0.016 J-	0.015	0.012	0.015 J-
Beryllium, Total	0.000052 J	0.001 U	0.01 U	0.00016 J	0.001 U				
Cadmium, Total	0.00062 J	0.002 U	0.02 U	0.002 U	0.002 U	0.002 U	0.002 U	0.001 U	0.001 U
Chromium, Total	0.00081	0.00011 J	0.005 U	0.0005 U	0.000098 J	0.0005 U	0.0005 U	0.0005 U	0.0005 U
Cobalt, Total	0.00024 J	0.001 U	0.007 J	0.001 U					
Lead, Total	0.014 J	0.015 J	0.018 J	0.023 J	0.022 J	0.014 J	0.017 J	0.019 J	0.016 J
Lithium, Total	0.022	0.019	0.016 J	0.038	0.049	0.044	0.059	0.055	0.067
Molybdenum, Total	0.000076 J	0.001 U	0.01 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Selenium, Total	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U
Thallium, Total	0.26 J	0.5 U	0.31 J	0.54	0.5 U	0.23 J	0.34 J	0.2 J+	0.32 J
Radiological (pCi/L)									
Radium-226	0.107 ± 0.0697	0.179 ± 0.0827	0.293 ± 0.242	-0.0341 U ± 0.180	0.130 ± 0.0873	0.145 ± 0.0840	0.0962 UJ ± 0.0743	R	0.100 ± 0.0637
Radium-228	0.214 U ± 0.278	0.161 UJ ± 0.287	0.0785 U ± 0.226	0.743 ± 0.259	0.294 U ± 0.220	0.208 U ± 0.204	0.222 U ± 0.289	0.198 U ± 0.226	0.330 U ± 0.233
Radium-226 & 228	0.321 U ± 0.287	0.339 UJ ± 0.298	0.372 U ± 0.332	R	0.424 J ± 0.236	0.354 J ± 0.221	0.318 U ± 0.298	0.522 J+ ± 0.249	0.430 J ± 0.242

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals
 CFR: Code of Federal Regulations
 ft amsl: feet above mean sea level
 MCL: Maximum Contaminant Level
 mg/L: milligram per liter
 mS/cm: millisiemen per centimeter
 mv: millivolt
 NA: Not Applicable
 NTU: Nephelometric Turbidity Units
 pCi/L: picoCurie per liter
 su: standard units
 USEPA: United States Environmental Protection Agency

QUALIFIERS:
 J: value is estimated
 J+: value is estimated with a potentially high bias
 J-: value is estimated with a potentially low bias
 R: value is rejected
 U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.
<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

Location Group	Downgradient								
	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6	CCR-AP-6
Location Name	CCR-AP-6-20160607	CCR-AP-6-20160810	CCR-AP-6-20161026	CCR-AP-6-20161206	CCR-AP-6-20170207	CCR-AP-6-20170404	CCR-AP-6-20170605	CCR-AP-6-20170926	CCR-AP-6-20171116
Sample Name	06/07/2016	08/10/2016	10/26/2016	12/06/2016	02/07/2017	04/04/2017	06/05/2017	09/26/2017	11/16/2017
Sample Date	180-55566-5	180-57528-20	180-60193-3	180-61491-6	180-63324-6	180-64974-6	180-67229-6	180-70809-6	180-72643-19
Lab Sample ID	447.90	447.74	445.41	446.06	447.62	445.63	446.05	443.90	443.36
Water Level (ft amsl)	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Detection
Monitoring Program									
Field Parameters									
Temperature (Deg C)	16.68	17.63	15.71	13.31	13.86	16.14	15.3	15.47	13.29
Turbidity, Field (NTU)	-	-	-	-	-	-	-	854.31	-
Dissolved Oxygen, Field (mg/L)	0.39	0.23	0.16	0.21	1.34	2.04	2.05	0.08	0.4
Conductivity, Field (mS/cm)	2.86715	2.622	2.34393	2.0108	2.10516	1.76314	2.25261	2.26168	2.1014
ORP, Field (mv)	30.1	12	18.27	28.3	5.82	21.67	-19.79	-23.68	16.07
Turbidity, Field (NTU)	58.7	47.74	50.74	20.35	20.98	171.35	-0.8	-	357.65
pH, Field (su)	6.9	6.89	7.01	6.97	7.02	6.98	7.07	6.98	6.93
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	2.2	2.2	1.4	0.88	0.83	0.98	1.5	0.95 J+	0.59
Calcium, Total	240	250	260	270	250	290	280	260	240
Chloride (mg/L)	150	150	130	100	100	110	130	110	100
Fluoride (mg/L)	0.12	0.1 U	0.18	0.24	0.2 J+	0.2	0.19 J	0.21 J+	0.21
Sulfate (mg/L)	1000	900 J-	920 J-	890	880	900	1100	930	880 J-
pH (lab) (su)	7.14 J	7.2 J	7.1 J	7.1 J	7.4 J	7.3 J	7.2 J	7.1 J	7.4 J
Total Dissolved Solids (TDS) (mg/L)	2100	2100	2000	1800	3300	1800	2100	1800	1700
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.00068 J
Arsenic, Total	0.0053	0.0045	0.0041	0.0039	0.0029 J+	0.0021	0.002	0.0032 J+	0.0044 J
Barium, Total	0.028	0.019	0.022 J-	0.021 J-	0.021	0.018 J-	0.018	0.026 J-	0.04 J-
Beryllium, Total	0.0001 J	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.00051 J	0.00042 J
Cadmium, Total	0.00021 J	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.00013 J	0.00013 J
Chromium, Total	0.0012 J	0.002 U	0.001 J	0.00048 J	0.002 U	0.002 U	0.002 U	R	0.0072 J+
Cobalt, Total	0.0068	0.0038	0.0032	0.0023	0.0013	0.001	0.0009	0.0033	0.0054
Lead, Total	0.0011	0.00023 J	0.00061 J	0.00028 J	0.001 U	0.001 U	0.001 U	0.005	0.0036 J
Lithium, Total	0.043 J	0.04 J	0.042 J	0.041 J	0.04 J	0.036 J	0.039 J	0.042 J	0.043 J
Molybdenum, Total	0.021	0.015	0.012	0.011	0.01	0.0086	0.009	0.0066	0.0089
Selenium, Total	0.00065 J	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.00006 J	0.001 U	0.000039 J	0.001 U	0.001 U	0.001 U	0.001 U	0.00018 J	0.000097 J
Mercury, Total	0.000055 J	0.0002 U	0.0002 U	0.0002 UJ	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 UJ
Fluoride (mg/L)	0.12	0.1 U	0.18	0.24	0.2 J+	0.2	0.19 J	0.21 J+	0.21
Radiological (pCi/L)									
Radium-226	0.162 ± 0.0727	0.177 ± 0.0778	0.195 U ± 0.228	0.278 U ± 0.281	0.0398 U ± 0.0860	0.120 ± 0.0878	0.0399 UJ ± 0.0601	1.10 J ± 0.398	0.122 ± 0.0669
Radium-228	-0.0541 U ± 0.342	-0.0414 UI ± 0.239	0.394 U ± 0.274	0.641 ± 0.284	0.0520 U ± 0.252	-0.0275 U ± 0.213	0.0246 ± 0.242	3.67 ± 1.20	0.406 ± 0.244
Radium-226 & 228	0.108 U ± 0.350	0.136 UJ ± 0.251	0.589 ± 0.356	R	0.0918 U ± 0.266	0.12 UI ± 0.230	0.0646 U ± 0.250	4.77 ± 1.26	0.528 ± 0.253

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals

CFR: Code of Federal Regulations

ft amsl: feet above mean sea level

MCL: Maximum Contaminant Level

mg/L: milligram per liter

mS/cm: millisiemen per centimeter

mV: millivolt

NA: Not Applicable

NTU: Nephelometric Turbidity Units

pCi/L: picoCurie per liter

su: standard units

USEPA: United States Environmental Protection Agency

QUALIFIERS:

J: value is estimated

J+: value is estimated with a potentially high bias

J-: value is estimated with a potentially low bias

R: value is rejected

U: Not detected value is the laboratory reporting limit

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals

from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE II
SUMMARY OF ANALYTICAL RESULTS
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA


Location Group	Downgradient								
	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R	CCR-AP-7R
Location Name	CCR-AP-7-20160609	CCR-AP-7-20160810	CCR-AP-7-20161026	CCR-AP-7R-20161205	CCR-AP-7R-20170206	CCR-AP-7R-20170425	CCR-AP-7R-20170605	CCR-AP-7R-20170926	CCR-AP-7R-20171114
Sample Name	06/09/2016	08/10/2016	10/26/2016	12/05/2016	02/06/2017	04/25/2017	06/05/2017	09/26/2017	11/14/2017
Sample Date	180-55607-7	180-57528-21	180-60193-4	180-61491-7	180-63324-7	180-65681-2	180-67229-7	180-70809-7	180-72643-20
Lab Sample ID	457.39	457.59	456.07	455.82	456.15	-	454.32	453.14	452.74
Water Level (ft amsl)	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Baseline	Detection
Monitoring Program									
Field Parameters									
Temperature (Deg C)	17.91	16.91	15.41	12.19	13.33	14.48	15.06	15.56	13.51
Turbidity, Field (NTU)	-	-	-	-	-	-	-	524.01	-
Dissolved Oxygen, Field (mg/L)	7.01	7.69	9.08	10.04	6.85	7.2	8.31	6.67	6.72
Conductivity, Field (mS/cm)	0.53443	4.234	4.08942	1.9895	4.16272	4.453	4.15439	4.62098	4.68238
ORP, Field (mv)	121.77	198	195.26	166.1	179.67	269	256.13	257.35	129.8
Turbidity, Field (NTU)	3.02	171.8	11.72	53.54	57.61	487.6	136.87	-	121.17
pH, Field (su)	6.49	6.37	6.47	6.31	6.43	6.42	6.46	6.53	6.51
Detection Monitoring - EPA Appendix III Constituents (mg/L)									
Boron, Total	0.011 U	5.4	3.7	3.6	3.4	4.1	4.1	2.7 J+	2.8
Calcium, Total	47	320	340	340	330	340	340	300	320
Chloride (mg/L)	26	300	320	320	290	320	330	260	280
Fluoride (mg/L)	R	0.25 U	0.17 J	0.25	0.25 U	0.2 J	0.19 J	R	0.094 J
Sulfate (mg/L)	15	1600 J-	1900 J-	2100	1900	2200	2100	2300	2400 J-
pH (lab) (su)	6.75 J	6.9 J	6.6 J	6.6 J	6.8 J	6.9 J	6.7 J	6.6 J	7.2 J
Total Dissolved Solids (TDS) (mg/L)	350	3700	3700	3600	3800	7800	4000	4100	3900
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)									
Antimony, Total	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.00059 J	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.00067 J	R	0.00061 J	0.00051 J	0.0016 J+	0.0032	0.0017	R	0.0014 J+
Barium, Total	0.024 J-	0.039	0.032 J-	0.033 J-	0.039	0.063	0.05	0.048 J-	0.039 J-
Beryllium, Total	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.00024 J	0.001 U	0.00013 J	0.001 U
Cadmium, Total	0.001 U	0.00032 J	0.00019 J	0.00015 J	0.00014 J	0.00015 J	0.0002 J	0.001 U	0.00011 J
Chromium, Total	0.0016 J	0.00093 J	0.00076 J	0.00093 J	0.0016 J	0.0063	0.0033	R	0.0029 J+
Cobalt, Total	0.0002 J	0.0039	0.0012	0.0012	0.0015	0.004	0.0023	0.0019	0.0013
Lead, Total	R	0.00041 J	0.00022 J	0.00014 J	0.00062 J	0.0033	0.0017	0.0018 J+	0.0011
Lithium, Total	0.011 J	0.02 J	0.024 J	0.025 J	0.023 J	0.03 J	0.021 J	0.025 J	0.022 J
Molybdenum, Total	0.0016 J	0.0011 J	0.005 U	0.005 U	0.005 U	0.005 U	0.00062 J	0.00065 J	0.005 U
Selenium, Total	0.005 U	0.0007 J	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.000054 J	0.001 U
Mercury, Total	0.0002 UJ	0.0002 U	0.0002 UJ	0.0002 UJ	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 UJ
Fluoride (mg/L)	R	0.25 U	0.17 J	0.25	0.25 U	0.2 J	0.19 J	R	0.094 J
Radiological (pCi/L)									
Radium-226	0.0958 J ± 0.0549	0.324 ± 0.149	0.284 ± 0.252	0.0965 U ± 0.221	0.164 ± 0.0985	0.350 ± 0.130	0.248 J ± 0.0930	R	0.217 ± 0.0812
Radium-228	-0.0103 U ± 0.186	0.127 UJ ± 0.584	0.157 U ± 0.248	0.347 U ± 0.251	0.193 U ± 0.275	0.0871 U ± 0.274	0.202 ± 0.223	0.450 U ± 0.305	0.559 ± 0.268
Radium-226 & 228	0.0856 U ± 0.194	0.451 UJ ± 0.603	0.441 ± 0.353	R	0.357 UJ ± 0.292	0.437 UJ ± 0.303	0.451 J ± 0.242	R	0.776 ± 0.280

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals
 CFR: Code of Federal Regulations
 ft amsl: feet above mean sea level
 MCL: Maximum Contaminant Level
 mg/L: milligram per liter
 mS/cm: millisiemen per centimeter
 mv: millivolt
 NA: Not Applicable
 NTU: Nephelometric Turbidity Units
 pCi/L: picoCurie per liter
 su: standard units
 USEPA: United States Environmental Protection Agency

QUALIFIERS:
 J: value is estimated
 J+: value is estimated with a potentially high bias
 J-: value is estimated with a potentially low bias
 R: value is rejected
 U: Not detected value is the laboratory reporting limit
 - USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.
<https://www.epa.gov/coalash/coal-ash-rule>

FIGURES

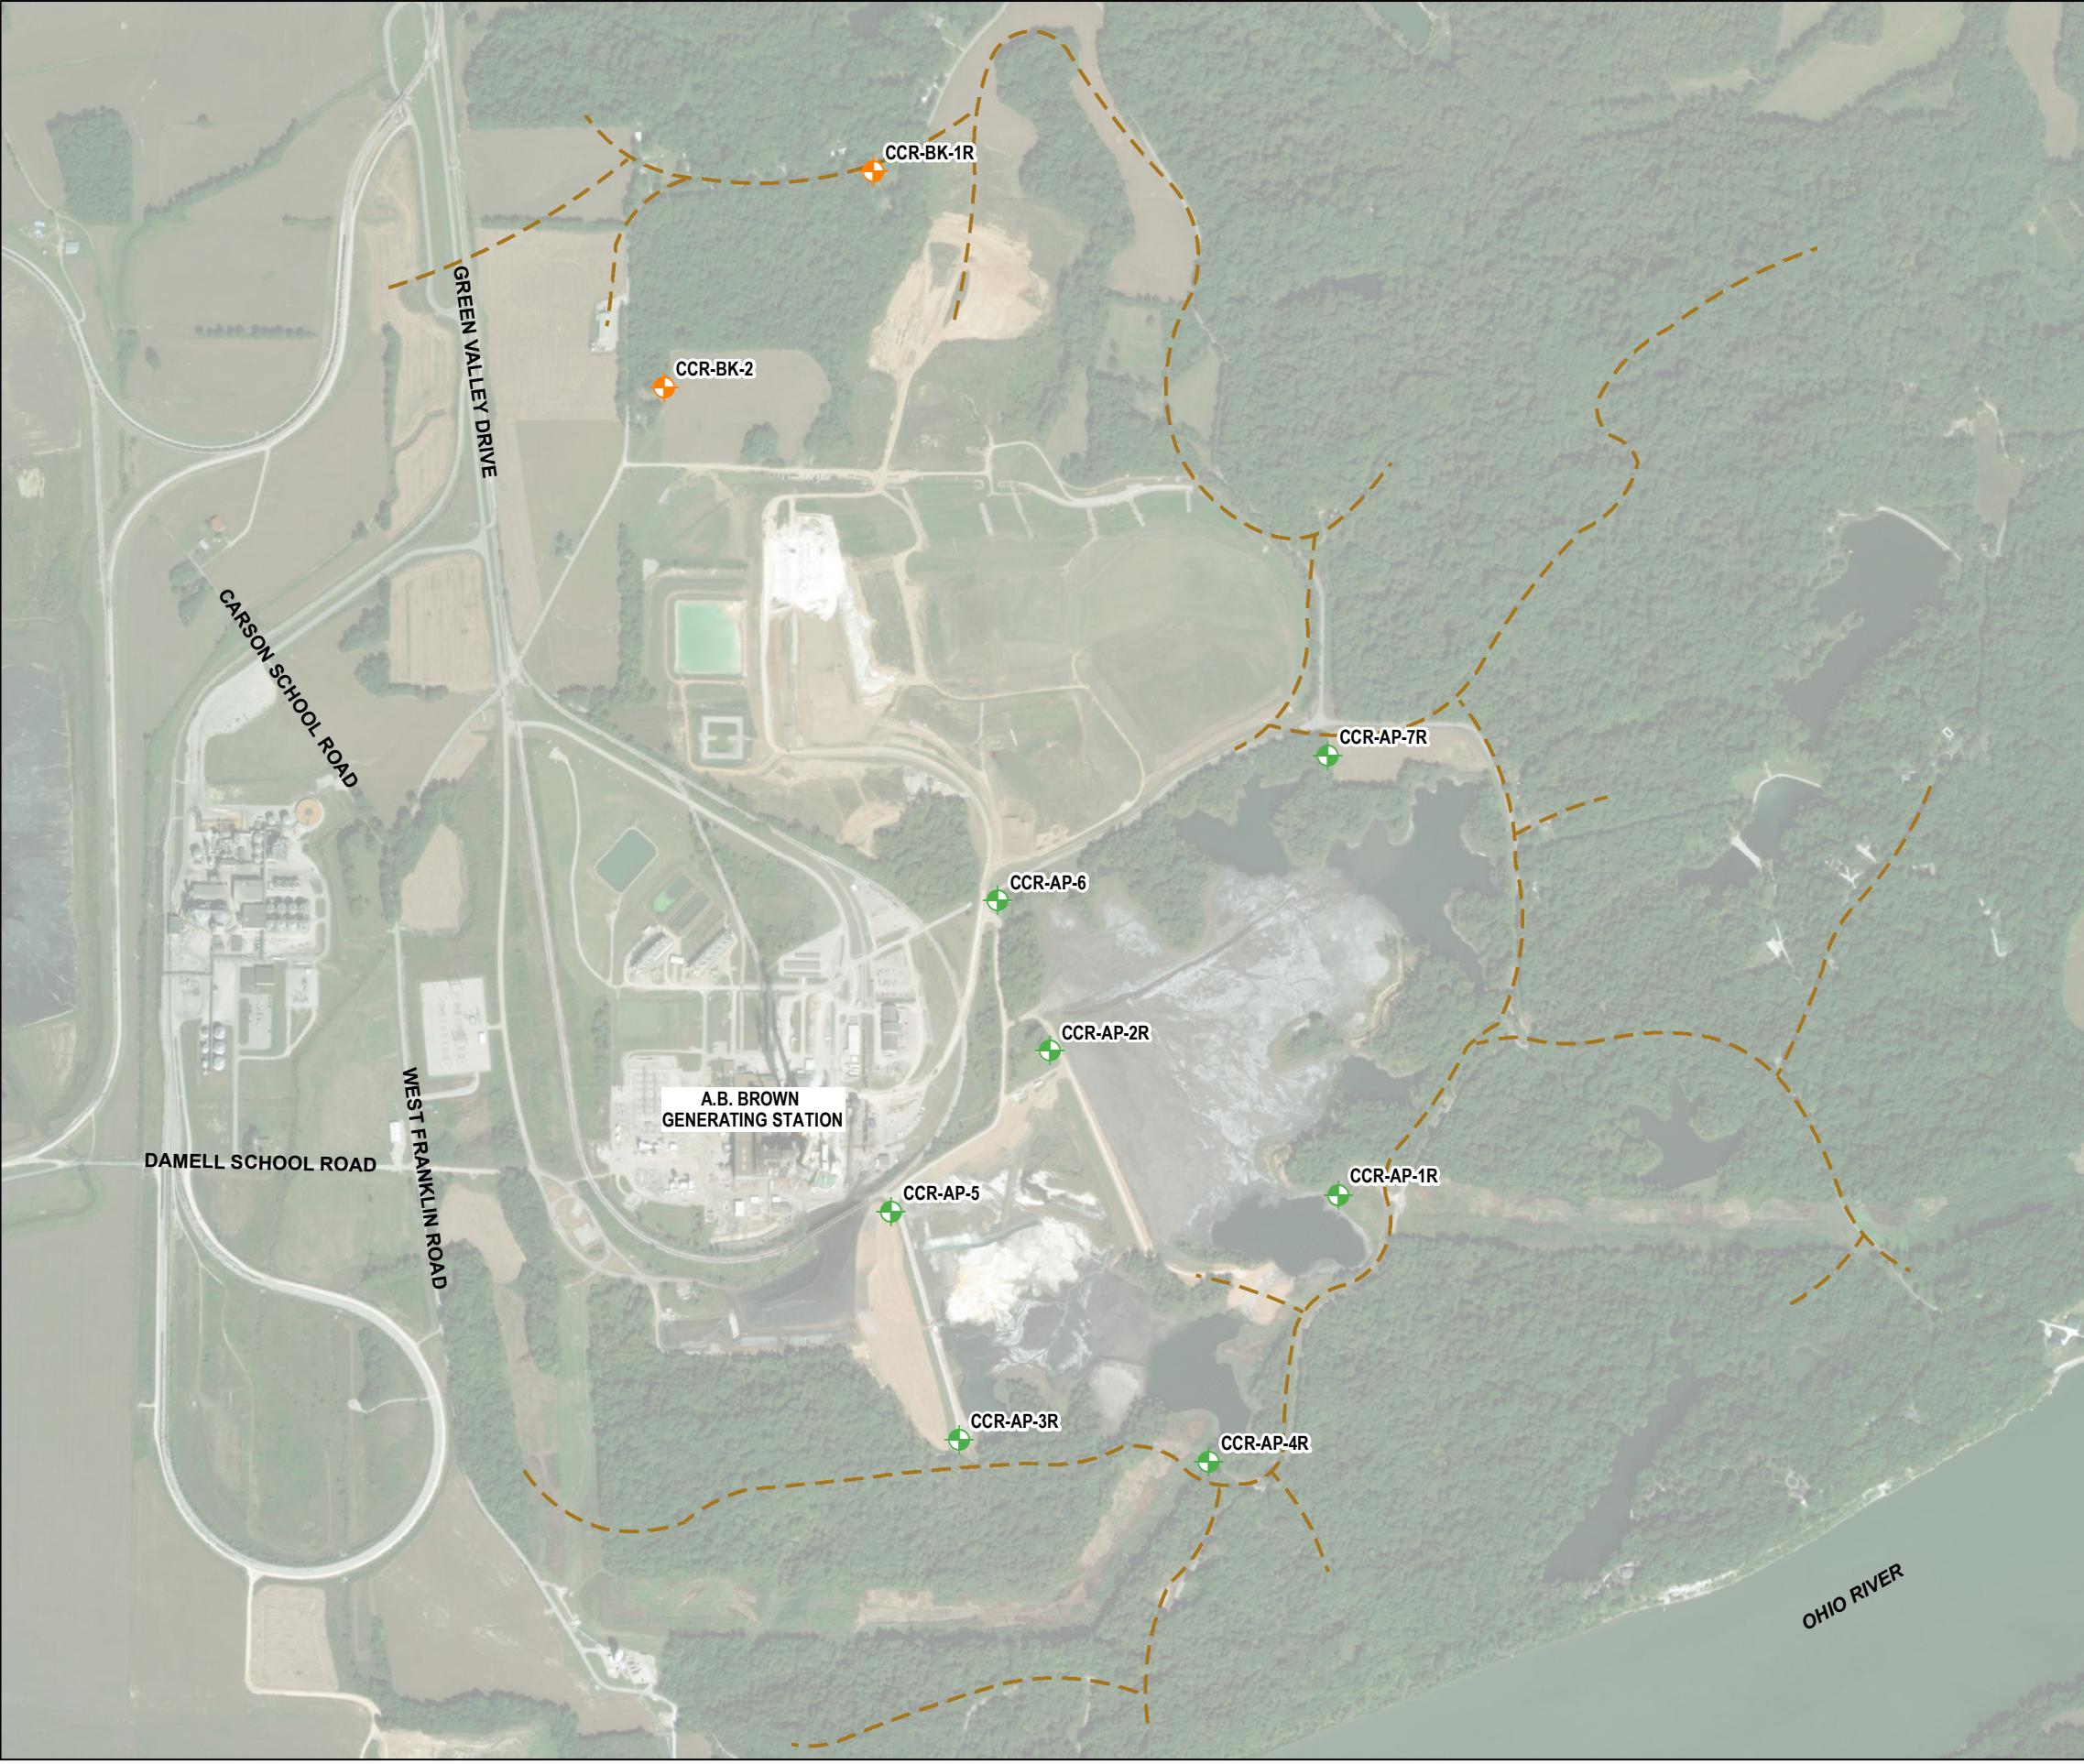

LEGEND

- UPGRADIENT MONITORING WELL
- DOWNGRADIENT MONITORING WELL
- TOPOGRAPHIC DIVIDE

NOTES

- LOCATIONS DERIVED FROM THREE I DESIGN DATA.
- ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
- AERIAL IMAGERY SOURCE: ESRI



0 500 1,000 1,500 2,000
SCALE IN FEET

HALEY
ALDRICH

VECTREN CORPORATION
A.B. BROWN GENERATING STATION
8511 WELBORN ROAD
MOUNT VERNON, IN 47620

MONITORING WELL NETWORK
ASH POND

JANUARY 2018

FIGURE 1